

ADDENDUM NO. 3
WATER SYSTEM IMPROVEMENTS
CONTRACT 2007-01 WATER TREATMENT PLANT IMPROVEMENTS
SMITH UTILITY DISTRICT
JRWCO JOB NO. 1881

BID DATE: Thursday, July 19, 2007, at
2:00 PM CDT

DATE OF ADDENDUM: July 13, 2007

1. DETAILED SPECIFICATIONS, Section 7. Painting, Paragraph 1. Scope: add
subparagraph c. Special Requirements:

"c. Special Requirements

(1) *Disposal of Lead-Contaminated Surface Preparation Debris*

Paint samples from the locations listed in the table below were tested for lead content in accordance with the requirements of Standard Methods 17th and 18th Edition; The Solid Waste Manual SW-846; EPA Methods for the Analysis of Water and Wastes and/or 40 CFR Part 136. The results are listed in Table 1.

<i>Table 1</i>	
<i>Lead Content of Paint Coatings</i>	
<i>mg/kg</i>	
<i>Ductile Iron Pipe in Pipe Gallery</i>	<i>Sample 1 – 19,000</i>
	<i>Sample 2 – 26,000</i>
	<i>Sample 3 – 60,000</i>
<i>Wall in Pipe Gallery</i>	<i>16,000</i>
<i>Handrail Around Basin No. 1</i>	<i>4,300</i>
<i>Handrail Around Basin No. 2</i>	<i>2,400</i>
<i>Handrail Around Basin No. 3</i>	<i>2,600</i>
<i>Door Frame in Old Fluoride Room</i>	<i>26,000</i>

(2) Contractor Responsibility Regarding Lead-Contaminated Paint Debris

The contractor shall possess the necessary qualifications to perform the required work.

The cleaning and surface preparation of all surfaces to be painted (or left un-coated) shall be accomplished by means determined by the contractor to render the waste non-hazardous. The contractor shall be responsible for all disposal costs (including testing and permitting) of any hazardous waste created during surface preparation. Surface preparation requirements are described in detail at Paragraph 6 of this section.


The contractor shall be solely responsible for meeting all requirements of the Tennessee Department of Environment and Conservation's Air Quality and the United States Environmental Protection Agency for Ambient Air Quality. Neither the Owner nor the Engineer will perform any air quality monitoring during the performance of this scope of work."

2. DETAILED SPECIFICATIONS, Section 7, Paragraph 6. Surface Preparation and Painting: delete subparagraph a (2) and substitute the following:

"(2) Surface Preparation – Ductile Iron Pipe

The contractor shall prepare the surface of the pipe in accordance with the provisions of NAPF 500-03-04 Abrasive Blast Cleaning – External Pipe Surfaces."

J. R. WAUFORD & COMPANY
CONSULTING ENGINEERS, INC.

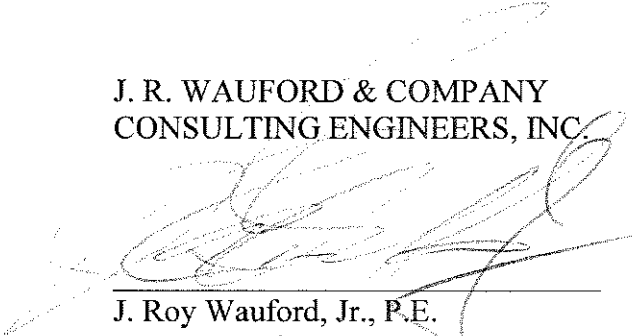

J. Roy Wauford, Jr., P.E.
Tennessee License No. 2792